



SPECTRA LOGIC BLACKPEARL NEARLINE GATEWAY SITE PREPARATION GUIDE



SpectraLogic.com

COPYRIGHT

Copyright © 2014-2025 Spectra Logic Corporation. All rights reserved. This item and the information contained herein are the property of Spectra Logic Corporation.

NOTICES

Except as expressly stated herein, Spectra Logic Corporation makes its products and associated documentation on an “AS IS” BASIS, WITHOUT WARRANTY OF ANY KIND, EITHER EXPRESSED OR IMPLIED, INCLUDING BUT NOT LIMITED TO THE IMPLIED WARRANTIES OF MERCHANTABILITY OR FITNESS FOR A PARTICULAR PURPOSE, BOTH OF WHICH ARE EXPRESSLY DISCLAIMED. In no event shall Spectra Logic be liable for any loss of profits, loss of business, loss of use or data, interruption of business, or for indirect, special, incidental or consequential damages of any kind, even if Spectra Logic has been advised of the possibility of such damages arising from any defect or error.

Information furnished in this manual is believed to be accurate and reliable. However, no responsibility is assumed by Spectra Logic for its use. Due to continuing research and development, Spectra Logic may revise this publication from time to time without notice, and reserves the right to change any product specification at any time without notice.

TRADEMARKS

ArcticBlue, BlackPearl, BlueScale, RioBroker, Spectra Cube, Spectra Logic, Spectra Vail, Spectra, SpectraGuard, StorCycle, TeraPack, TFinity, and TranScale are registered trademarks of Spectra Logic Corporation. All rights reserved worldwide. All other trademarks and registered trademarks are the property of their respective owners.

PART NUMBER

90990094 Revision K

REVISION HISTORY

Revision	Date	Description
G	July 2018	Updated for BlackPearl 5.0 release.
H	March 2020	Updated for BlackPearl 5.1.5 release.
I	January 2022	Updated to add Gen2 chassis.
J	April 2025	Updated to add Gen3 chassis and 77-bay expansion node.
K	September 2025	Updated with Gen 3 3310 chassis.

Note: To make sure you have the most current version of this guide check the Spectra Logic Technical Support portal at support.spectralogic.com/documentations/user-guides/.

END USER LICENSE

1. READ CAREFULLY

YOU SHOULD READ THE FOLLOWING TERMS AND CONDITIONS BEFORE ACCEPTING THIS END-USER LICENSE AGREEMENT ("EULA"). THIS EULA IS A LEGAL AGREEMENT BETWEEN YOUR ORGANIZATION, THE END USER, AND SPECTRA LOGIC CORPORATION ("SPECTRA") FOR THE SPECTRA SOFTWARE PRODUCT WHICH INCLUDES COMPUTER SOFTWARE AND MAY INCLUDE ASSOCIATED MEDIA, PRINTED MEDIA, AND "ONLINE" OR ELECTRONIC DOCUMENTATION (COLLECTIVELY, "SOFTWARE PRODUCT"). BY INSTALLING, COPYING, OR OTHERWISE USING THE SOFTWARE PRODUCT, YOU AGREE TO BE BOUND BY THE TERMS OF THIS EULA. IF YOU DO NOT AGREE TO THE TERMS OF THIS EULA, YOU MAY NOT INSTALL, COPY, DOWNLOAD OR USE THE SOFTWARE PRODUCT. YOU AGREE THAT YOUR USE OF THE SOFTWARE ACKNOWLEDGES THAT YOU HAVE READ THIS AGREEMENT, UNDERSTAND IT, AND AGREE TO BE BOUND BY ITS TERMS AND CONDITIONS.

2. OWNERSHIP

It is understood and agreed that Spectra Logic Corporation, a Delaware corporation with offices at 6285 Lookout Road, Boulder, CO 80301 ("Licensor") is the owner of all right, title and interest to the Software Product, regardless of the media or form of the original download, whether by the World Wide Web, disk or otherwise. You, as licensee ("Licensee") through your downloading, installing, copying or use of this product do not acquire any ownership rights to the Software Product.

3. GENERAL

The Software Product is licensed, not sold, to you by Spectra for use only under the terms of this EULA. The Software Product is protected by copyright laws and international copyright treaties, as well as other intellectual property laws and treaties. The rights granted herein are limited to Spectra's and its licensors' intellectual property rights in the Software Product and do not include any other patents or intellectual property rights. The terms of this EULA will govern any software upgrades provided by Spectra that replace and/or supplement the original Software Product, unless such upgrade is accompanied by a separate license in which case the terms of that license will govern.

4. SOFTWARE PRODUCT

The Software Product, as used in this EULA, means, collectively and/or as applicable:

- Related explanatory written materials and instructions, and any other possible documentation related thereto ("Documentation"); and
- Upgrades, modified versions, updates, additions and copies of the Software Product (the "Upgrades"), if any, licensed to by Spectra under this EULA.
- The Software Product package;
- Any and all contents, components, attachments, software, media, and code with which this Agreement is provided and delivered;
- Any and all images, photographs, art, art work, clip art, fonts or other artistic works (the "Art Work");

5. GRANT OF LICENSE AND RESTRICTIONS

- A. Spectra grants you a non-exclusive, non-transferable End-User license right to install the Software Product solely for the purpose for which it was created.

-
- B.** Unless provided otherwise in the Documentation or by prior express written consent of Spectra, you shall not display, modify, reproduce and distribute any Art Work, or portion(s) thereof, included with or relating to the Software Product, if any. Any such authorized display, modification, reproduction and distribution shall be in full accord with this EULA. Under no circumstances will your use, display, modification, reproduction and distribution of the Art Work give you any Intellectual Property or Proprietary Rights of the Art Work. All rights, title, and interest belong solely to Spectra.
 - C.** Except for the initial loading of the Software Product, you shall not, without Spectra's express written consent:
 - Copy or reproduce the Software Product; or
 - Modify, adapt, or create derivative works based on the Software Product or any accompanying materials.

6. DESCRIPTION OF OTHER RIGHTS AND LIMITATIONS

- A.** Spectra will provide you with support services related to the Software Product ("Support"). Such Support will be provided in accordance with the Spectra Master Support Agreement, available for download and viewing on the Spectra Corporate Web site. Use of Support is governed by this EULA and Spectra's Master Support Agreement.
- B.** Any supplemental software, code, content, or media provided to you in the course of Support shall be considered part of the Software Product and subject to the terms and conditions of this EULA.
- C.** Spectra retains all right, title, and interest in and to the Software Product, and any rights not granted to you herein are reserved by Spectra. You hereby expressly agree not to extract information, reverse engineer, disassemble, decompile, or translate the Software Product, or otherwise attempt to derive the source code of the Software, except to the extent allowed under any applicable law. In the event that such activities are permitted by applicable law, any information you, or your authorized agent, discover shall be promptly disclosed to Spectra and shall be deemed the confidential information of Spectra.
- D.** You shall not modify, sublicense, assign, or transfer the Software Product or any rights under this EULA, except as expressly provided in this EULA. Any attempt to sublicense, assign, or transfer any of the rights, duties, or obligations will be void.
- E.** You may permanently transfer all of your rights under this EULA, provided you retain no copies. The other party must agree to accept the terms and conditions of the EULA.

7. ALL RESERVED

All rights not expressly granted herein are reserved by Spectra.

8. TERM

- A.** This License is effective until terminated. Licensee may terminate it at any time by destroying the Software Product with all copies, full or partial, and removing all of its component parts.
- B.** Your rights under this EULA will terminate automatically without notice from Spectra if you fail to comply with any term(s) or condition(s) of this EULA. In such event, no notice shall be required by Spectra to effect such termination.
- C.** Upon termination of this EULA, you shall cease all use of the Software Product and destroy all copies, full or partial, together with all backup copies, modifications, printed or written materials, and merged portions in any form and remove all component parts of the Software Product.

9. INTELLECTUAL PROPERTY RIGHTS

- A. Spectra shall retain all right, title, and interest in the Software Product and to any modifications or improvements made thereto, and any upgrades, updates or Documentation provided to End User. End User will not obtain any rights in the Software Product, its updates, upgrades, and Documentation, as a result of its responsibilities hereunder.
- B. End User acknowledges Spectra's exclusive rights in the Software Product and that the Software Product is unique and original to Spectra and that Spectra is owner thereof. Unless otherwise permitted by law, End User shall not, at any time during or after the effective Term of the Agreement, dispute or contest, directly or indirectly, Spectra's exclusive right and title to the Software Product or the validity thereof.

10. U.S. GOVERNMENT END USERS

The Software Product and related documentation are "Commercial Items," as that term is defined at 48 C.F.R. §2.101, consisting of "Commercial Computer Software" and "Commercial Computer Software Documentation," as such terms are used in 48 C.F.R. §12.212 or 48 C.F.R. §§227.7202-1 through 227.7202-4, as applicable. The Commercial Computer Software and Commercial Computer Software Documentation are being licensed to U.S. Government end users (a) only as Commercial Items and (b) with only those rights as are granted to all other End Users pursuant to the terms and conditions herein. Unpublished rights reserved under the copyright laws of the United States.

11. EXPORT LAW ASSURANCES

You may not use or otherwise export or re-export the Software Product except as authorized by United States law and the laws of the jurisdiction in which the Software Product was obtained. In particular, but without limitation, the Software Product may not be exported or re-exported (a) into (or to a nation or resident of) any U.S. embargoed countries or (b) to anyone on the U.S. Treasury Department's list of Specially Designated Nationals or the U.S. Department of Commerce Denied Persons List or Entity List. By installing or using any component of the Software Product, you represent and warrant that you are not located in, under control of, or a national or resident of any such country or on any such list.

12. DISCLAIMER OF WARRANTIES

YOU EXPRESSLY ACKNOWLEDGE AND AGREE THAT USE OF THE SOFTWARE PRODUCT IS AT YOUR SOLE RISK AND THAT THE ENTIRE RISK AS TO SATISFACTORY QUALITY, PERFORMANCE, ACCURACY AND EFFORT IS WITH YOU. TO THE MAXIMUM EXTENT PERMITTED BY APPLICABLE LAW, AND EXCEPT AS MAY BE STATED IN THE SPECTRA MASTER SERVICE AGREEMENT, THE SOFTWARE PRODUCT IS PROVIDED "AS IS," WITH ALL FAULTS AND WITHOUT WARRANTY OF ANY KIND, AND SPECTRA AND SPECTRA'S AFFILIATES (COLLECTIVELY REFERRED TO AS "SPECTRA" FOR THE PURPOSES OF SECTIONS 12 AND 13) HEREBY DISCLAIM ALL WARRANTIES AND CONDITIONS WITH RESPECT TO THE SOFTWARE PRODUCT, EITHER EXPRESS, IMPLIED OR STATUTORY, INCLUDING, BUT NOT LIMITED TO, THE IMPLIED WARRANTIES AND/OR CONDITIONS OF MERCHANTABILITY, OF SATISFACTORY QUALITY, OF FITNESS FOR A PARTICULAR PURPOSE, OF ACCURACY, OF QUIET ENJOYMENT, AND NON-INFRINGEMENT OF THIRD-PARTY RIGHTS. SPECTRA DOES NOT WARRANT AGAINST INTERFERENCE WITH YOUR ENJOYMENT OF THE SOFTWARE PRODUCT THAT THE FUNCTIONS CONTAINED IN THE SOFTWARE PRODUCT WILL MEET YOUR REQUIREMENTS, THAT THE OPERATION OF THE SOFTWARE PRODUCT WILL BE UNINTERRUPTED OR ERROR-FREE, OR THAT DEFECTS IN THE SOFTWARE PRODUCT WILL BE CORRECTED. NO ORAL OR WRITTEN INFORMATION OR ADVICE GIVEN BY SPECTRA OR A SPECTRA AUTHORIZED REPRESENTATIVE SHALL CREATE A WARRANTY. SOME JURISDICTIONS DO NOT ALLOW THE EXCLUSION OF IMPLIED WARRANTIES OR LIMITATION ON APPLICABLE STATUTORY RIGHTS OF A CONSUMER, SO THE ABOVE EXCLUSION AND LIMITATIONS MAY NOT APPLY TO YOU.

13. LIMITATION OF LIABILITY

TO THE MAXIMUM EXTENT PERMITTED BY APPLICABLE LAW, IN NO EVENT SHALL SPECTRA, ITS AFFILIATES OR LICENSEES, BE LIABLE FOR ANY SPECIAL, INCIDENTAL, INDIRECT, OR CONSEQUENTIAL DAMAGES WHATSOEVER (INCLUDING, WITHOUT LIMITATION, DAMAGES FOR LOSS OF BUSINESS PROFITS, BUSINESS INTERRUPTION, LOSS OF BUSINESS INFORMATION, OR ANY OTHER PECUNIARY LOSS) ARISING OUT OF THE USE OF OR INABILITY TO USE THE SOFTWARE PRODUCT OR THE PROVISION OF OR FAILURE TO PROVIDE SUPPORT SERVICES, EVEN IF SPECTRA HAS BEEN ADVISED OF THE POSSIBILITY OF SUCH DAMAGES. IN ANY CASE, SPECTRA'S ENTIRE LIABILITY UNDER ANY PROVISION OF THIS EULA SHALL BE LIMITED TO THE AMOUNT ACTUALLY PAID BY YOU FOR THE SOFTWARE PRODUCT; PROVIDED HOWEVER, IF YOU HAVE ENTERED INTO A MASTER SUPPORT AGREEMENT, SPECTRA'S ENTIRE LIABILITY REGARDING SUPPORT SERVICES SHALL BE GOVERNED BY THE TERMS OF THAT AGREEMENT. BECAUSE SOME STATES AND JURISDICTIONS DO NOT ALLOW THE EXCLUSION OR LIMITATION OF LIABILITY, THE ABOVE LIMITATION MAY NOT APPLY TO YOU.

14. CONTROLLING LAW AND SEVERABILITY

This EULA will be governed by and construed in accordance with the laws of the State of Colorado, as applied to agreements entered into and to be performed entirely within Colorado between Colorado residents. This EULA shall not be governed by the United Nations Convention on Contracts for the International Sale of Goods, the application of which is expressly excluded. If for any reason a court of competent jurisdiction finds any provision, or portion thereof, to be unenforceable, the remainder of this EULA shall continue in full force and effect.

SYSTEM BIOS

Resetting the system BIOS when not authorized by Spectra Logic Technical Support invalidates the system configuration. Spectra Logic reserves the right to charge for time and materials to reconfigure and recertify the system.

CONTACTING SPECTRA LOGIC

To Obtain General Information	
Spectra Logic Website: spectrallogic.com	
United States Headquarters	European Office
Spectra Logic Corporation 6285 Lookout Road Boulder, CO 80301 USA Phone: 1.800.833.1132 or 1.303.449.6400 International: 1.303.449.6400 Fax: 1.303.939.8844	Spectra Logic Europe Ltd. 329 Doncastle Road Bracknell Berks, RG12 8PE United Kingdom Phone: 44 (0) 870.112.2150 Fax: 44 (0) 870.112.2175
Spectra Logic Technical Support	
Technical Support Portal: support.spectrallogic.com	
United States and Canada Phone: Toll free US and Canada: 1.800.227.4637 International: 1.303.449.0160	Europe, Middle East, Africa Phone: 44 (0) 870.112.2185 Deutsch Sprechende Kunden Phone: 49 (0) 6028.9796.507
Additional international numbers available at support.spectrallogic.com/home If you have a Spectra Logic Portal account, please log in for country-specific numbers at support.spectrallogic.com/support-contact-info	
Spectra Logic Sales	
Website: shop.spectrallogic.com	
United States and Canada Phone: 1.800.833.1132 or 1.303.449.6400 Fax: 1.303.939.8844 Email: sales@spectrallogic.com	Europe Phone: 44 (0) 870.112.2150 Fax: 44 (0) 870.112.2175 Email: eurosales@spectrallogic.com
To Obtain Documentation	
support.spectrallogic.com/documentations	

Table of Contents

Contacting Spectra Logic	7
About This Guide	10
Intended Audience	10
Overview	10
Related Information	11
Related Publications	11
Tape Library User Guides	12
Site Preparation Checklist	14
Site Preparation	16
Physical Requirements	17
Shipping Size and Weight	17
Unpacked Size and Weight	19
Maximum Configuration Size and Weight	21
Work Area	23
Fire Protection	23
Flooring	24
Stability & Bolt Down Kits	29
Environmental Specifications	30
Temperature & Humidity	30
Heat Generation	35
Power Requirements	36
Input Power Requirements	36
Power Cord Specifications	39
Interface Specifications	42
System Interface Connectors	42
Expansion Node and Tape Drive Interface Connectors	47
Network Interface Cables	47
Networking Naming Conventions	48
Universal Serial Bus (USB) Support	49
Rack-Mount Requirements	50
Two-Post Rack Restriction	50
BlackPearl Master Nodes and 44-Bay Expansion Node	50
77-Bay Expansion Node	51

96-Bay Expansion Node	51
107-Bay Expansion Node	52
Rack Mount Tipping Best Practice	53

ABOUT THIS GUIDE

This guide describes site preparation for the Spectra® BlackPearl® Nearline Gateway. Use the information in this guide to prepare your site for the installation of the system.

This guide also describes the site preparation requirements for the Spectra 44-bay, 77-bay, 96-bay, and 107-bay expansion nodes. The expansion nodes are used in conjunction with the BlackPearl gateway and cannot be used as stand-alone products. When instructions in this guide apply to both the BlackPearl master and expansion nodes, *BlackPearl system*, or *the system* are used to refer to both.

INTENDED AUDIENCE

This guide is intended for data center administrators and operators who maintain and operate file storage systems. The information in this guide assumes a familiarity with computing terminology and with network connectivity protocols such as SAS, Fibre Channel, and Ethernet. If your BlackPearl system installation includes a tape library, knowledge of tape-based backup systems and how to use the library is required. You also need to be familiar with installing, configuring, and using data file storage and data management software.

OVERVIEW

The BlackPearl Nearline gateway allows data to move seamlessly into tape storage in a way not previously possible. It enables users to deploy a tier of deep storage that is cost effective, easy to manage, and scalable to exabytes of data.

RELATED INFORMATION

This section contains information about this document and other documents related to the Spectra BlackPearl Nearline Gateway.

Typographical Conventions

This document uses the following conventions to highlight important information:

**WARNING**

Read text marked by the “Warning” icon for information you must know to avoid personal injury.

**CAUTION**

Read text marked by the “Caution” icon for information you must know to avoid damaging the hardware or losing data.

**IMPORTANT**

Read text marked by the “Important” icon for information that helps you complete a procedure or avoid extra steps.

Note: Read text marked with “Note” for additional information or suggestions about the current topic.

Related Publications

For additional information about the Spectra BlackPearl Nearline gateway and the DS3 interface, refer to the publications listed in this section.

Spectra BlackPearl Nearline Gateway

The following documents related to the Spectra BlackPearl Nearline gateway are available on the Support Portal website at support.spectralogic.com, and from the Documentation screen in the BlackPearl user interface.

- The [Spectra BlackPearl Nearline Gateway User Guide](#) provides detailed information about configuring, using, and maintaining your BlackPearl gateway.
- The [Spectra BlackPearl Rack Mounting Instructions Guide](#) provides detailed instructions for installing a Gen1 BlackPearl gateway in a standard rack.
- The [Spectra BlackPearl Network Setup Tips](#) document provides helpful instructions for troubleshooting common connectivity problems.
- The [Spectra BlackPearl DS3 API Reference](#) provides information on understanding and using the DS3 API.

The following documents are available after logging into your Support portal account at: support.spectrallogic.com.

- The *Spectra BlackPearl Release Notes and Documentation Updates* provide the most up-to-date information about the BlackPearl gateway, including information about the latest software releases and documentation updates.
- The *BlackPearl Eon Browser User Guide* provides installation and usage information for the Spectra Eon browser.
- The *Spectra 12- & 36-Drive Chassis HBA Installation Guide* provides instructions for installing an HBA in a Gen1 master node.
- The *Spectra 12- & 36-Drive Chassis Boot Drive Replacement Guide* provides instructions for replacing a failed boot drive in a Gen1 master node.
- The *Spectra 12-, 36- & 45-Drive Chassis Drive Replacement Guide* provides instructions for replacing a failed data drive in a Gen1 master node or 44-bay expansion node.
- The *Spectra 12-, 36- & 45-Drive Chassis Fan Replacement Guide* provides instructions for replacing a failed fan in a Gen1 master node or 44-bay expansion node.
- The *Spectra 12-, 36- & 45-Drive Chassis Power Supply Replacement Guide* provides instructions for replacing a failed power supply in a Gen1 master node or 44-bay expansion node.
- The *Spectra 12-Drive Chassis HBA Replacement Guide* and *Spectra 36-Drive Chassis HBA Replacement Guide* provide instructions for replacing a failed HBA in a Gen1 master node.
- The *Spectra 96-Bay Chassis Drive Replacement Guide* provides instructions for replacing a failed data drive in the 96-bay expansion node.
- The *Spectra 96-Bay Chassis Fan Replacement Guide* provides instructions for replacing a failed fan in the 96-bay expansion node.
- The *Spectra 96-Bay Chassis Power Supply Replacement Guide* provides instructions for replacing a failed power supply in the 96-bay expansion node.
- The *Spectra 96-Bay Chassis I/O Module Replacement Guide* provides instructions for replacing a failed I/O module in the 96-bay expansion node.
- The *Spectra 107-Bay Expansion Node FRU Guide* provides instructions for replacing fans, power supplies, drives, and SAS expanders in the 77-bay and 107-bay expansion node.

Tape Library User Guides

Spectra Logic Tape Libraries

User Guides for Spectra Logic tape libraries are posted on the Support Portal website at: support.spectrallogic.com/documentations/user-guides.

IBM Tape Libraries

User Guides for compatible IBM® tape libraries are posted on the IBM Knowledge Center website at: ibm.com/support/knowledgecenter/products/.

SITE PREPARATION CHECKLIST

Use the checklist to ensure that all of the site preparation requirements are met prior to delivery of your system and, optionally, one or more expansion nodes.

Status	Description
☐	Physical requirements are met (see Physical Requirements on page 17). • Access to the system is restricted to authorized personnel. • There is room for unpacking and moving the system. • The installation area has a level, hard flooring that can support the weight of the rack and system. BlackPearl master nodes and 44-bay expansion nodes • There is at least 36 inches (91.4 cm) of clearance in front and behind the system. • Recommended - A fire suppression system is in place. • Required - A rack stability kit is installed. • Recommended - A rack bolt down kit is installed. • Recommended - A server lift. 77-bay expansion nodes • There is at least 36 inches (91.4 cm) of clearance in front and behind the system. • Recommended - A fire suppression system is in place. • Required - A rack bolt down kit is installed. • Required - A server lift. 96-bay expansion nodes and 107-bay expansion nodes • There is at least 48 inches (122 cm) of clearance in front and behind the system. • Recommended - A fire suppression system is in place. • Required - A rack bolt down kit is installed. • Required - A server lift.
☐	Environmental requirements are met (see Environmental Specifications on page 30). • The temperature, humidity, and altitude are within the system's specifications. • The location is as free of airborne particulates as possible.
☐	Power requirements are met (see Power Requirements on page 36). • A sufficient number of power outlets are installed near the back of the system, and are accessible when the system is fully inserted into the rack. • Power cords meet country and local electrical codes.
☐	Network cable requirements are addressed (see Interface Specifications on page 42).

Status	Description
	The correct number and types of network cables are available.
☐	Rack-mount requirements are met (see Rack-Mount Requirements on page 50). BlackPearl Gen1 master node, Gen2 X series or V series master node, and 44-bay expansion nodes - The rack is of a sufficient size to hold the system including cable clearance in back and clearance between the front door frame and the front mounting posts of the rack to allow the door to close over the front bezel. - The rack can safely handle the weight of the system. - The rack is assembled. BlackPearl Gen2 S series master node, 77-bay expansion nodes, 96-bay expansion nodes, and 107-bay expansion nodes - The rack is of a sufficient size to hold the system including cable clearance in back and clearance between the front door frame and the front mounting posts of the rack to allow the door to close over the front bezel. - The rack can safely handle the weight of the system. - The rack is assembled. - The rack is affixed to the floor to eliminate the risk of tipping when a fully loaded chassis is extended from the rack.  WARNING Failure to anchor the rack to the floor could allow the rack to tip over which could cause personal injury. WARNUNG Wenn das Rack nicht am Boden verankert wird, kann das Rack umkippen, was zu Verletzungen führen kann.

SITE PREPARATION

This chapter describes the site requirements for the BlackPearl gateway master nodes and 44-bay, 77-bay, 96-bay, and 107-bay expansion nodes. Make sure that the location where the system is used meets these requirements before installing the system.

Physical Requirements	17
Environmental Specifications	30
Power Requirements	36
Interface Specifications	42
Rack-Mount Requirements	50

PHYSICAL REQUIREMENTS

The following physical requirements apply to the operating location of the BlackPearl Nearline gateway. Meeting these requirements is necessary for successfully operating the system.

Restricted Access

Ensure that your installation location is only accessible to authorized personnel.

Shipping Size and Weight

The following table provides the shipping size and weight specifications for the systems.

Note: All dimensions and weights are approximate.

Chassis	Height	Width	Depth	Weights ^{a, r}
Gen1 V Series 2U master node	13.25 in. (33.6 cm)	26 in. (66 cm)	34.25 in. (87.0 cm)	12-drive configuration: 80.5 lb (36.5 kg)
Gen1 S or P Series master node or 44-bay expansion node	17.5 in. (44.5 cm)	27 in. (68.6 cm)	39 in. (99.0 cm)	20-drive configuration: 127.4 lb (57.8 kg)
Gen2 X Series master node				
Gen2 V Series master node	11.5 in. (29.2 cm)	23.7 in. (60.2 cm)	45 in. (114.3 cm)	
Gen2 S Series master node	15.9 in. (40.4 cm)	23.7 in. (60.2 cm)	46.9 in. (119.1 cm)	
Gen3 F Series master node	12 in. (30.5 cm)	25 in. (73.6 cm)	37 in. (94 cm)	77 lb (35 kg)
Gen3 H Series master node	18 in. (45.7 cm)	25 in. (73.6 cm)	39 in. (99 cm)	114 lb (51.8 kg)
77-bay expansion node	21.1 in. (53.6 cm)	26.6 in. (67.6 cm)	44.1 in. (112 cm)	• Empty chassis: 127 lb (57.8 kg) • Rack mounting kit: 21 lb (9.5 kg)

a) Includes chassis, drives, and packaging.

Chassis	Height	Width	Depth	Weights ^{a, ,}
96-bay expansion node	14 in. (35.6 cm)	24.5 in. (62.2 cm)	43.5 in. (110.5 cm)	• Empty chassis: 108 lb (49 kg) • Rack mounting kit: 21 lb (9.5 kg)
107-bay expansion node	18.4 in. (46.7 cm)	24.3 in. (61.7 cm)	52.3 in. (132.8 cm)	• Empty chassis: 154.5 lb (70.1 kg) • Rack mounting kit: 21 lb (9.5 kg)


WARNING

Lifting hazard. Use lifting aids and proper lifting techniques with assistance when handling heavy equipment.

WARNUNG Gefahren beim Heben. Verwenden Sie Hebehilfen und richtige Hebetechnik mit Unterstützung beim Umgang mit schwerem Gerät.

^{a)} Includes chassis, drives, and packaging.

Unpacked Size and Weight

The following table provides the unpacked size and weight specifications for the systems.

Note: All dimensions and weights are approximate.

Chassis	Height	Width	Depth ^a	Weights
Gen1 V Series 2U master node	2U—3.5 in. (8.9 cm)	19 in. (48.3 cm)	27.5 in. (69.9 cm)	• Empty chassis: 39 lb (17.7 kg) • 12-drive configuration: 60.6 lb (27.5 kg)
Gen1 S or P Series 4U master node or 44-bay expansion node	4U—7 in. (17.8 cm)	19 in. (48.3 cm)	29 in. (73.7 cm)	• Empty chassis: 57 lb (25.8 kg) • 20-drive configuration: 93.2 lb (42.3 kg) • 35-drive configuration: 120.2 lb (54.5 kg) • 44-drive configuration: 136.4 lb (61.9 kg)
Gen2 X Series master node	2U—3.5 in. (8.9 cm)	19 in. (48.3 cm)	33 in. (83.8 cm)	• Empty chassis: 60 lb (27.2 kg) • Additional for each SSD: 0.8 lb (0.4 kg)
Gen2 V Series master node	2U—3.5 in. (8.9 cm)	19 in. (48.3 cm)	27.5 in. (69.9 cm)	• Empty chassis: 72 lb (32.7 kg) • Additional for each HDD: 1.5 lb (0.8 kg) • Additional for each SSD: 0.8 lb (0.4 kg)
Gen2 S Series master node	4U—6.9 in. (17.6 cm)	19 in. (48.3 cm)	37.5 in. (95.3 cm)	• Empty chassis: 99 lb (45 kg) • Additional for each HDD: 1.5 lb (0.8 kg) • Additional for each SSD: 0.8 lb (0.4 kg)

^a) Includes the front bezel.

Chassis	Height	Width	Depth ^a	Weights
Gen3 F Series master node	2U—3.5 in. (8.9 cm)	19 in. (48.3 cm)	30 in. (76.2 cm)	• Empty chassis: 55 lb (25 kg) • With 24 NVMe: 67 lb (30.4 kg)
Gen3 H Series master node	4U—7 in. (17.8 cm)	19 in. (48.3 cm)	29 in. (73.7 cm)	• Empty chassis: 75 lb (34 kg) • With 24 SAS: 111 lb (50.4 kg)
77-bay expansion node	4U—7 in. (17.8 cm)	19 in. (48.3 cm)	32 in. (81 cm)	• Empty chassis: 88.5 lb (40.1 kg) • With 77 SSDs: 150 lb (68 kg) • With 77 HDDs: 204 lb (92.5 kg)
96-bay expansion node	4U—7 in. (17.8 cm)	19 in. (48.3 cm)	40 in. (101.6 cm)	• Empty chassis: 97 lb (44 kg) • Additional for each HDD: 1.8 lb (0.8 kg) • With 96 HDDs: 270 lb (122.5 kg)
107-bay expansion node	4U—7 in. (17.8 cm)	19 in. (48.3 cm)	41 in. (104.1 cm)	• Empty chassis: 109.4 lb (49.6 kg) • With 107 SSDs: 195 lb (88.5 kg) • With 107 HDDs: 270 lb (122.5 kg)


WARNING

Lifting hazard. Use lifting aids and proper lifting techniques with assistance when handling heavy equipment.

WARNUNG Gefahren beim Heben. Verwenden Sie Hebehilfen und richtige Hebetechnik mit Unterstützung beim Umgang mit schwerem Gerät.

^{a)} Includes the front bezel.

Maximum Configuration Size and Weight

The following table shows the maximum configuration for each master node type and the size and weight of the combined units.

Note: All dimensions and weights are approximate.



WARNING

Lifting hazard. Use lifting aids and proper lifting techniques with assistance when handling heavy equipment.

WARNUNG Gefahren beim Heben. Verwenden Sie Hebehilfen und richtige Hebetechnik mit Unterstützung beim Umgang mit schwerem Gerät.

Gen1 Chassis

Chassis	Height	Width	Depth ^a	Weight
One Gen1 V Series 2U master node and two 44-bay expansion nodes	17.5 in. (44.5 cm)	19 in. (48.3 cm)	29 in. (73.7 cm)	337 lb (152.9 kg) ^b
One Gen1 V Series 2U master node and two 77-bay expansion nodes	17.5 in. (44.5 cm)	19 in. (48.3 cm)	32 in. (81 cm)	468.6 lb (212.6 kg) ^b
One Gen1 V Series 2U master node and two 96-bay expansion nodes	17.5 in. (44.5 cm)	19 in. (48.3 cm)	40 in. (101.6 cm)	600.2 lb (272.2 kg) ^b
One Gen1 V Series 2U master node and two 107-bay expansion nodes	17.5 in. (44.5 cm)	19 in. (48.3 cm)	41 in. (104.1 cm)	600.6 lb (272.4 kg) ^b
One Gen1 S or P Series 4U master node and nine 44-bay expansion nodes	63 in. (160 cm)	19 in. (48.3 cm)	29 in. (73.7 cm)	1364 lb (618.7 kg) ^c
One Gen1 S or P Series 4U master node and nine 77-bay expansion nodes	63 in. (160 cm)	19 in. (48.3 cm)	32 in. (81 cm)	1956.2 lb (887.3 kg) ^c

^a) Includes the front bezel.

^b) Weight includes the weight of 2 rack kits used for the expansion nodes. Each rack kit weighs 21 lb (9.5 kg).

^c) Weight includes the weight of 9 rack kits used for the expansion nodes. Each rack kit weighs 21 lb (9.5 kg).

Chassis	Height	Width	Depth ^a	Weight
One Gen1 S or P Series 4U master node and nine 96-bay expansion nodes	63 in. (160 cm)	19 in. (48.3 cm)	40 in. (101.6 cm)	2550.2 lb (1156.8 kg) ^c
One Gen1 S or P Series 4U master node and nine 107-bay expansion nodes	63 in. (160 cm)	19 in. (48.3 cm)	41 in. (104.1 cm)	2550.2 lb (1156.8 kg) ^c

Gen2 Chassis

Chassis	Height	Width	Depth ^a	Weight
One Gen2 X Series 2U master node and eight 77-bay expansion nodes	59.5 in. (151.1 cm)	19 in. (48.3 cm)	32 in. (81 cm)	1879.2 lb (852.4 kg) ^b
One Gen2 X Series 2U master node and eight 107-bay expansion nodes	59.5 in. (151.1 cm)	19 in. (48.3 cm)	41 in. (104.1 cm)	2407.2 lb (1091.9 kg) ^b
One Gen2 V Series 2U master node and nine 77-bay expansion nodes	66.5 in. (169 cm)	19 in. (48.3 cm)	32 in. (81 cm)	2133 lb (967.5 kg) ^c
One Gen2 V Series 2U master node and nine 107-bay expansion nodes	66.5 in. (169 cm)	19 in. (48.3 cm)	41 in. (104.1 cm)	2727 lb (1237 kg) ^c
One Gen2 S Series 4U master node and nine 77-bay expansion nodes	70 in. (177.8 cm)	19 in. (48.3 cm)	32 in. (81 cm)	2214 lb (1004.2 kg) ^c
One Gen2 S Series 4U master node and nine 107-bay expansion nodes	70 in. (177.8 cm)	19 in. (48.3 cm)	41 in. (104.1 cm)	2808 lb (1272.7 kg) ^c

^a) Includes the front bezel.

^b) Weight includes the weight of 8 rack kits used for the expansion nodes. Each rack kit weighs 21 lb (9.5 kg).

^c) Weight includes the weight of 9 rack kits used for the expansion nodes. Each rack kit weighs 21 lb (9.5 kg).

Gen3 Chassis

Chassis	Height	Width	Depth ^a	Weight
One Gen3 H Series 2U master node and eight 77-bay expansion nodes	59.5 in. (151.1 cm)	19 in. (48.3 cm)	32 in. (81 cm)	1867 lb (846.9 kg) ^b
One Gen3 H Series 2U master node and eight 107-bay expansion nodes	59.5 in. (151.1 cm)	19 in. (48.3 cm)	41 in. (104.1 cm)	2395 lb (1086.4 kg) ^b
One Gen2 F Series 4U master node and eight 77-bay expansion nodes	63 in. (160 cm)	19 in. (48.3 cm)	32 in. (81 cm)	1911 lb (866.8 kg) ^b
One Gen2 V Series 4U master node and eight 107-bay expansion nodes	63 in. (160 cm)	19 in. (48.3 cm)	41 in. (104.1 cm)	2439 lb (1106.3 kg) ^b

Work Area

Working Area - All BlackPearl master nodes

Spectra Logic requires a minimum of 36 inches (91.4 cm) of clearance both in front and in back of the system for ventilation and access during installation, operation, and service.

Working Area - 44-Bay Expansion Nodes and 77-bay Expansion Nodes

Spectra Logic requires a minimum of 36 inches (91.4 cm) of clearance both in front and in back of the system for ventilation and access during installation, operation, and service.

Working Area - 96-Bay Expansion Nodes and 107-bay Expansion Nodes

Spectra Logic requires a minimum of 48 inches (122 cm) of clearance both in front and in back of the system for ventilation and access during installation, operation, and service.

Fire Protection

If possible, install the BlackPearl gateway close to your data center's fire suppression equipment.

^a) Includes the front bezel.

^b) Weight includes the weight of 8 rack kits used for the expansion nodes. Each rack kit weighs 21 lb (9.5 kg).

Flooring

Flooring

Place the rack on a level, hard-surfaced floor such as cement or tile. Do not place the rack on a carpeted floor or anywhere else that poses risk for static discharge that could damage your system or its drives.

Floor Load / Tipping Hazard

The data center flooring must be able to support the weight of a fully loaded rack with 10 units. Additionally, any rack containing a 96-bay expansion node or 107-bay expansion node must be anchored to the floor to prevent the rack from tipping over, which could cause personal injury.

Rack Mount Tipping Best Practice

It is a best practice to place a BlackPearl chassis in the lowest part of the rack as possible to prevent tipping.

Floor Load & Tipping Warnings - Gen1 Chassis



WARNING

A fully loaded **BlackPearl gateway Gen1 V Series 2U system with 44-bay expansion nodes** weighs 337 lb (152.9 kg). **Serious damage and personal injury could occur if the floor collapses or if the rack tips over.**

A fully loaded **BlackPearl gateway Gen1 V Series 2U system with 77-bay expansion nodes** weighs 468.6 lb (212.6 kg). **Serious damage and personal injury could occur if the floor collapses or if the rack tips over.**

A fully loaded **BlackPearl gateway Gen1 V Series 2U system with 96-bay expansion nodes** weighs 600.2 lb (272.2 kg). **Serious damage and personal injury could occur if the floor collapses or if the rack tips over.**

A fully loaded **BlackPearl gateway Gen1 V Series 2U system with 107-bay expansion nodes** weighs 600.6 lb (272.4 kg). **Serious damage and personal injury could occur if the floor collapses or if the rack tips over.**

A fully loaded **BlackPearl gateway Gen1 S or P Series 4U system with 44-bay expansion nodes** weighs 1364 lb (618.7 kg). **Serious damage and personal injury could occur if the floor collapses or if the rack tips over.**

A fully loaded **BlackPearl gateway Gen1 S or P Series 4U system with 77-bay expansion nodes** weighs 1956.2lb (887.3 kg). **Serious damage and personal injury could occur if the floor collapses or if the rack tips over.**

A fully loaded **BlackPearl gateway Gen1 S or P Series 4U system with 96-bay expansion nodes** weighs 2550.2 lb (1156.8 kg). **Serious damage and personal injury could occur if the floor collapses or if the rack tips over.**

A fully loaded **BlackPearl gateway Gen1 S or P Series 4U system with 107-bay expansion nodes** weighs 2550.2 lb (1156.8 kg). **Serious damage and personal injury could occur if the floor collapses or if the rack tips over.**

Floor Load & Tipping Warnungen - Gen1 Chassis



WARNUNG

Eine voll beladene **BlackPearl gateway Gen1 V Series 2U-System** mit **44-Schacht-Erweiterungsknoten** wiegt 152,9 kg. Ein Einstürzen des Bodens oder ein Umkippen des Racks können zu schweren Schäden und Personenschäden führen.

Eine voll belastete **BlackPearl gateway Gen1 V Series 2U-System** mit **77-Schacht-Erweiterungsknoten** wiegt 212,6 kg. Ein Einstürzen des Bodens oder ein Umkippen des Racks können zu schweren Schäden und Personenschäden führen.

Eine voll belastete **BlackPearl gateway Gen1 V Series 2U-System** mit **96-Schacht-Erweiterungsknoten** wiegt 272,2 kg. Ein Einstürzen des Bodens oder ein Umkippen des Racks können zu schweren Schäden und Personenschäden führen.

Eine voll beladene **BlackPearl gateway Gen1 V Series 2U-System** mit **107-Schacht-Erweiterungsknoten** wiegt 272,4 kg. Ein Einstürzen des Bodens oder ein Umkippen des Racks können zu schweren Schäden und Personenschäden führen.

Eine voll beladene **BlackPearl gateway Gen1 S- oder P-Serie 4U-System** mit **44-Bay-Erweiterungsknoten** wiegt 618,7 kg. Ein Einstürzen des Bodens oder ein Umkippen des Racks können zu schweren Schäden und Personenschäden führen.

Eine voll beladene **BlackPearl gateway Gen1 S- oder P Series 4U-System** mit **77-Bay-Erweiterungsknoten** wiegt 887,3 kg. Ein Einstürzen des Bodens oder ein Umkippen des Racks können zu schweren Schäden und Personenschäden führen.

Eine voll beladene **BlackPearl gateway Gen1 S- oder P Series 4U-System** mit **96-Bay-Erweiterungsknoten** wiegt 1156,8 kg. Ein Einstürzen des Bodens oder ein Umkippen des Racks können zu schweren Schäden und Personenschäden führen.

Eine voll beladene **BlackPearl gateway Gen1 S oder P Series 4U-System** mit **107-Schacht-Erweiterungsknoten** wiegt 1156,8 kg. Ein Einstürzen des Bodens oder ein Umkippen des Racks können zu schweren Schäden und Personenschäden führen.

Floor Load & Tipping Warnings - Gen2 Chassis



WARNING

A fully loaded **BlackPearl gateway Gen2 X Series 2U system with 77-bay expansion nodes** weighs 1879.2 lb (852.4 kg). **Serious damage and personal injury could occur if the floor collapses or if the rack tips over.**

A fully loaded **BlackPearl gateway Gen2 X Series 2U system with 107-bay expansion nodes** weighs 2407.2 lb (1091.9 kg). **Serious damage and personal injury could occur if the floor collapses or if the rack tips over.**

A fully loaded **BlackPearl gateway Gen2 V Series 2U system with 77-bay expansion nodes** weighs 2133 lb (967.5 kg). **Serious damage and personal injury could occur if the floor collapses or if the rack tips over.**

A fully loaded **BlackPearl gateway Gen2 V Series 2U system with 107-bay expansion nodes** weighs 2727 lb (1237 kg). **Serious damage and personal injury could occur if the floor collapses or if the rack tips over.**

A fully loaded **BlackPearl gateway Gen2 S Series 4U system with 77-bay expansion nodes** weighs 2214 lb (1004.2 kg). **Serious damage and personal injury could occur if the floor collapses or if the rack tips over.**

A fully loaded **BlackPearl gateway Gen2 S Series 4U system with 107-bay expansion nodes** weighs 2808 lb (1272.7 kg). **Serious damage and personal injury could occur if the floor collapses or if the rack tips over.**

Floor Load & Tipping Warnungen - Gen2 Chassis



WARNUNG

Eine voll beladene **BlackPearl gateway Gen2 X Series 2U-System mit 77-Bay-Erweiterungsknoten** wiegt 852,4 kg. **Ein Einstürzen des Bodens oder ein Umkippen des Racks können zu schweren Schäden und Personenschäden führen.**

Eine voll beladene **BlackPearl gateway Gen2 X Series 2U-System mit 107-Bay-Erweiterungsknoten** wiegt 1091,9 kg. **Ein Einstürzen des Bodens oder ein Umkippen des Racks können zu schweren Schäden und Personenschäden führen.**

Eine voll beladene **BlackPearl gateway Gen2 V Series 2U-System mit 77-Schacht-Erweiterungsknoten** wiegt 967,5 kg. **Ein Einstürzen des Bodens oder ein Umkippen des Racks können zu schweren Schäden und Personenschäden führen.**

Eine voll beladene **BlackPearl gateway Gen2 V Series 2U-System mit 107-Schacht-Erweiterungsknoten** wiegt 1237 kg. **Ein Einstürzen des Bodens oder ein Umkippen des Racks können zu schweren Schäden und Personenschäden führen.**

Eine voll belastete **BlackPearl gateway Gen2 S Series 4U-System mit 77-Schacht-Erweiterungsknoten** wiegt 1004,2 kg. **Ein Einstürzen des Bodens oder ein Umkippen des Racks können zu schweren Schäden und Personenschäden führen.**

Eine voll belastete **BlackPearl gateway Gen2 S Series 4U-System mit 107-Schacht-Erweiterungsknoten** wiegt 1272,7 kg. **Ein Einstürzen des Bodens oder ein Umkippen des Racks können zu schweren Schäden und Personenschäden führen.**

Floor Load & Tipping Warnings - Gen3 Chassis



WARNING

A fully loaded **BlackPearl gateway Gen3 H Series 2U system with 77-bay expansion nodes** weighs 1867 lb (846.9 kg). **Serious damage and personal injury could occur if the floor collapses or if the rack tips over.**

A fully loaded **BlackPearl gateway Gen3 H Series 2U system with 107-bay expansion nodes** weighs 2395 lb (1086.4 kg). **Serious damage and personal injury could occur if the floor collapses or if the rack tips over.**

A fully loaded **BlackPearl gateway Gen3 F Series 2U system with 77-bay expansion nodes** weighs 1911 lb (866.8 kg). **Serious damage and personal injury could occur if the floor collapses or if the rack tips over.**

A fully loaded **BlackPearl gateway Gen3 F Series 2U system with 107-bay expansion nodes** weighs 2439 lb (1106.3 kg). **Serious damage and personal injury could occur if the floor collapses or if the rack tips over.**

Floor Load & Tipping Warnings - Gen3 Chassis



WARNUNG

Eine voll beladene **BlackPearl gateway Gen3 H Series 2U-System mit 77-Bay-Erweiterungsknoten** wiegt 846,9 kg. **Ein Einstürzen des Bodens oder ein Umkippen des Racks können zu schweren Schäden und Personenschäden führen.**

Eine voll beladene **BlackPearl gateway Gen3 H Series 2U-System mit 107-Bay-Erweiterungsknoten** wiegt 1086,4 kg. **Ein Einstürzen des Bodens oder ein Umkippen des Racks können zu schweren Schäden und Personenschäden führen.**

Eine voll beladene **BlackPearl gateway Gen3 F Series 2U-System mit 77-Bay-Erweiterungsknoten** wiegt 866,8 kg. **Ein Einstürzen des Bodens oder ein Umkippen des Racks können zu schweren Schäden und Personenschäden führen.**

Eine voll beladene **BlackPearl gateway Gen3 F Series 2U-System mit 107-Bay-Erweiterungsknoten** wiegt 1106,3 kg. **Ein Einstürzen des Bodens oder ein Umkippen des Racks können zu schweren Schäden und Personenschäden führen.**

Stability & Bolt Down Kits

Stability Kit - All Gen 1 and Gen 2 X and V Master Nodes, and 44-Bay Expansion Nodes

In earthquake-prone areas, it is important to adequately restrain file storage systems to prevent personal injury and limit potential damage to system components.



WARNING

In earthquake-prone areas, the rack must have stabilizing equipment or be anchored to the floor to eliminate the risk of tipping, which could lead to personal injury.

WARNUNG In erdbebengefährdeten Gebieten muss das Rack stabilisierende Ausrüstung oder am Boden verankert, um die Kippgefahr, die zu Verletzungen führen können beseitigt werden.

Bolt Down Kit - Gen 2 S Master Nodes, and 77-bay, 96-Bay, and 107-Bay Expansion Nodes

When installing one or more Gen 2 S master nodes, 77-bay expansion nodes, 96-bay expansion nodes, or 107-bay expansion nodes, use a bolt down kit, such as the one shipped with the rack available from Spectra Logic, to prevent personal injury and limit potential damage to system components.



WARNING

The rack must be anchored to the floor before a Gen 2 S master node, 77-bay expansion node, 96-bay expansion node, or 107-bay expansion node is installed to eliminate the risk of tipping when a fully loaded chassis is extended from the rack, which could lead to personal injury.

WARNUNG Das Rack muss am Boden verankert werden, bevor ein Gen 2 S-Masterknoten, 77-Schacht-Erweiterungsknoten, 96-Schacht-Erweiterungsknoten oder 107-Schacht-Erweiterungsknoten installiert wird, um die Kippgefahr zu beseitigen, wenn ein voll beladenes Gehäuse herausgezogen wird des Racks, was zu Verletzungen führen kann.

ENVIRONMENTAL SPECIFICATIONS

Temperature & Humidity

The tables below show the temperature, humidity, and altitude requirements for each chassis.

Gen3 F Series BlackPearl Gateway

Parameter	Operating Environment ^a	Storing and Shipping (Non-Operating) Environment ^b	Transit Conditions Storage Environment
Humidity		5% to 95% (non-condensing)	10% to 90% (non-condensing)
Temperature	32° F to 86° F ^c (0° C to 30° C)	–4° F to 158° F (–20° C to 70° C)	–40° F to 140° F (–40° C to 60° C)
Altitude	-200 ft to 10,000 ft (-61 m to 3,048 m)	-200 ft to 10,000 ft (-61 m to 3,048 m)	-200 ft to 40,000 ft (-61 m to 12,192 m)
Maximum wet bulb temperature			

a) When moving the BlackPearl gateway or expansion node from a cold storage environment to a warm operating environment, it must acclimate in its packaging for at least 12 hours before opening to prevent serious condensation damage.

b) Specifications are for the BlackPearl gateway or expansion node in its original packaging. The packaging protects the BlackPearl gateway from condensation caused by extreme temperature variations (27° F per hour or 15° C per hour, or more).

c) Maximum operating temperature is specified at sea level and is 2 percent lower per 1,000 ft (305 m) of increased altitude.

Gen3 H Series 3300 & 3310 BlackPearl Gateway

Parameter	Operating Environment ^a	Storing and Shipping (Non-Operating) Environment ^b	Transit Conditions Storage Environment
Humidity		5% to 95% (non-condensing)	10% to 90% (non-condensing)
Temperature	32° F to 95° F ^c (0° C to 35° C)	−4° F to 158° F (−20° C to 70° C)	−40° F to 140° F (−40° C to 60° C)
Altitude	-200 ft to 10,000 ft (-61 m to 3,048 m)	-200 ft to 10,000 ft (-61 m to 3,048 m)	-200 ft to 40,000 ft (-61 m to 12,192 m)
Maximum wet bulb temperature			

Gen2 X Series BlackPearl Gateway

Parameter	Operating Environment ^a	Storing and Shipping (Non-Operating) Environment ^b	Transit Conditions Storage Environment
Humidity	20% to 80% (non-condensing)	10% to 90% (non-condensing)	10% to 90% (non-condensing)
Temperature	41° F to 95° F ^c (5° C to 35° C)	−40° F to 113° F (−40° C to 45° C)	−40° F to 140° F (−40° C to 60° C)
Altitude	-200 ft to 10,000 ft (-61 m to 3,048 m)	-200 ft to 10,000 ft (-61 m to 3,048 m)	-200 ft to 40,000 ft (-61 m to 12,192 m)
Maximum wet bulb temperature	84° F (29° C)	95° F (35° C)	

a) When moving the BlackPearl gateway or expansion node from a cold storage environment to a warm operating environment, it must acclimate in its packaging for at least 12 hours before opening to prevent serious condensation damage.

b) Specifications are for the BlackPearl gateway or expansion node in its original packaging. The packaging protects the BlackPearl gateway from condensation caused by extreme temperature variations (27° F per hour or 15° C per hour, or more).

c) Maximum operating temperature is specified at sea level and is 2 percent lower per 1,000 ft (305 m) of increased altitude.

Gen2 S Series and Gen2 V Series BlackPearl Gateway

Parameter	Operating Environment ^a	Storing and Shipping (Non-Operating) Environment ^b
Humidity	5% to 95% (non-condensing)	5% to 95% (non-condensing)
Temperature	50° F to 95° F (10° C to 35° C)	32° F to 122° F (0° C to 50° C)
Altitude	-200 ft to 10,000 ft (-61 m to 3,048 m)	-200 ft to 10,000 ft (-61 m to 3,048 m)
Maximum wet bulb temperature	84° F (29° C)	95° F (35° C)

Gen1 S Series and Gen1 V Series BlackPearl Gateway

Parameter	Operating Environment ^a	Storing and Shipping (Non-Operating) Environment ^b
Humidity	8% to 90% (non-condensing)	5% to 95% (non-condensing)
Temperature	50° F to 95° F (10° C to 35° C)	-40° F to 158° F (-40° C to 70° C)
Altitude	Sea level to 10,000 ft (3,048 m)	Sea level to 39,370 ft (12,000 m)
Maximum wet bulb temperature	84° F (29° C)	95° F (35° C)

a) When moving the BlackPearl gateway or expansion node from a cold storage environment to a warm operating environment, it must acclimate in its packaging for at least 12 hours before opening to prevent serious condensation damage.

b) Specifications are for the BlackPearl gateway or expansion node in its original packaging. The packaging protects the BlackPearl gateway from condensation caused by extreme temperature variations (27° F per hour or 15° C per hour, or more).

44-Bay Expansion Node

Parameter	Operating Environment ^a	Storing and Shipping (Non-Operating) Environment ^b
Humidity	8% to 90% (non-condensing)	5% to 95% (non-condensing)
Temperature	50° F to 95° F (10° C to 35° C)	–40° F to 158° F (–40° C to 70° C)
Altitude	Sea level to 10,000 ft (3,048 m)	Sea level to 39,370 ft (12,000 m)
Maximum wet bulb temperature	84° F (29° C)	95° F (35° C)

77-Bay Expansion Node

Parameter	Operating Environment ^a	Storing and Shipping (Non-Operating) Environment ^b
Humidity	20% to 80% (non-condensing)	10% to 90% (non-condensing)
Temperature	32° F to 95° F (0° C to 35° C)	–4° F to 140° F (–20° C to 60° C)
Altitude	–200 ft to 10,000 ft (–61 m to 3,048 m)	–200 ft to 40,000 ft (–61 m to 12,192 m)

a) When moving the BlackPearl gateway or expansion node from a cold storage environment to a warm operating environment, it must acclimate in its packaging for at least 12 hours before opening to prevent serious condensation damage.

b) Specifications are for the BlackPearl gateway or expansion node in its original packaging. The packaging protects the BlackPearl gateway from condensation caused by extreme temperature variations (27° F per hour or 15° C per hour, or more).

96-Bay Expansion Node

Parameter	Operating Environment ^a	Storing and Shipping (Non-Operating) Environment ^b
Humidity	20% to 80% (non-condensing)	10% to 90% (non-condensing)
Temperature	41° F to 95° F (5° C to 35° C)	–40° F to 140° F (–40° C to 60° C)
Altitude	–200 ft to 10,000 ft (–61 m to 3,048 m)	–200 ft to 40,000 ft (–61 m to 12,192 m)

107-Bay Expansion Node

Parameter	Operating Environment ^a	Storing and Shipping (Non-Operating) Environment ^b
Humidity	20% to 80% (non-condensing)	10% to 90% (non-condensing)
Temperature	32° F to 95° F (0° C to 35° C)	–4° F to 140° F (–20° C to 60° C)
Altitude	–200 ft to 10,000 ft (–61 m to 3,048 m)	–200 ft to 40,000 ft (–61 m to 12,192 m)

a) When moving the expansion node from a cold storage environment to a warm operating environment, it must acclimate in its packaging for at least 12 hours before opening to prevent serious condensation damage.

b) Specifications are for the expansion node in its original packaging. The packaging is designed to protect the expansion node from condensation caused by extreme temperature variations (27° F per hour or 15° C per hour, or more).

Heat Generation

The following table shows the approximate heat generation of each BlackPearl chassis.

Chassis	Heat Generation at Maximum Wattage
Gen3 F Series 2U master node	3412-5459 BTUs/hour
Gen3 H Series 4U master node	2729 - 4092 BTUs/hour
Gen2 X Series 2U master node	5460 BTUs/hour
Gen2 V Series 2U master node	2729 BTUs/hour
Gen2 S Series 4U master node	5460 BTUs/hour
Gen1 V Series 2U master node	3138 BTUs/hour
Gen1 S or P Series 4U master node	3410 - 4365 BTUs/hour
44-bay expansion node	3751 - 4775 BTUs/hour
77-bay expansion node	3950 BTUs/hour
96-bay expansion node	3751 BTUs/hour
107-bay expansion node	6820 BTUs/hour

POWER REQUIREMENTS

The BlackPearl gateways, 44-bay, 77-bay, 96-bay, and 107-bay expansion nodes, have the following power requirements.

**CAUTION**

Failure to meet the cabling and power specifications could damage your BlackPearl gateway, result in data loss, or both.

Input Power Requirements

The following tables provide the input power requirements for each gateway or expansion node.

Gen3 F Series BlackPearl Gateway

Parameter	Requirements
Input Voltage	100-120 VAC, 13 A, 1000 watts maximum 200-240 VAC, 10 A, 1600 watts maximum
Input Frequency	50-60 Hz

Gen3 H Series 3300 and 3310 BlackPearl Gateway

Parameter	Requirements
Input Voltage	100-127 VAC, 10 A, 800 watts maximum 200-240 VAC, 8 A, 1200 watts maximum
Input Frequency	50-60 Hz

Gen2 X Series BlackPearl Gateway

Parameter	Requirements
Input Voltage	200-240 VAC, 7 A, 1600 watts maximum
Input Frequency	50-60 Hz

Gen2 V Series BlackPearl Gateway

Parameter	Requirements
Input Voltage	100-240 VAC, 8-4 A, 800 watts maximum
Input Frequency	50-60 Hz

Gen2 S Series BlackPearl Gateway

Parameter	Requirements
Input Voltage	200-240 VAC, 10 A, 1600 watts maximum
Input Frequency	50-60 Hz

Gen1 V Series 2U BlackPearl Gateway

Parameter	Requirements
Input Voltage	100-240 VAC, 11-4.5 A, 920 watts maximum
Input Frequency	50-60 Hz

Gen1 S Series 4U BlackPearl Gateway

Parameter	Requirements
Input Voltage	100-140 VAC, 12-8 A, 1000 watts maximum 180-240 VAC, 8-6 A, 1280 watts maximum
Input Frequency	50-60 Hz

44-Bay Expansion Node

Parameter	Requirements
Input Voltage	100-140 VAC, 13.5-9.5 A, 1100 watts maximum 180-240 VAC, 9.5-7 A, 1400 watts maximum
Input Frequency	50-60 Hz

77-Bay Expansion Node

Parameter	Requirements
Input Voltage	200–240 VAC, 12 A, 1600 watts maximum
Input Frequency	50–60 Hz

96-Bay Expansion Node

Parameter	Requirements
Input Voltage	90–264 VAC, 1100 watts maximum
Input Frequency	47–63 Hz

107-Bay Expansion Node

Parameter	Requirements
Input Voltage	200–240 VAC, 15 A, 2000 watts maximum
Input Frequency	50–60 Hz

Power Cord Specifications

The power cords included with the BlackPearl gateways are part of the unit and are not intended for use with any other equipment.



IMPORTANT

Confirm the PDU used with the BlackPearl gateway has enough amperage for the power supply in each chassis included in your installation.

Cables provided by Spectra Logic are between 6 ft (1.8m) to 6.5 ft (2m) in length. If you need to use a longer cord, make sure it conforms to the specifications listed below.

Power cords must comply with local electrical codes.




WARNING

Using extension cords in conjunction with the cords provided with a 77-bay expansion node, a 96-bay expansion node, or 107-bay expansion node, may cause serious damage.

WARNUNG Die Verwendung von Verlängerungskabeln in Verbindung mit den Kabeln, die mit einem 77-Schacht-Erweiterungsknoten, 96-Schacht-Erweiterungsknoten, oder 107-Schacht-Erweiterungsknoten geliefert werden, kann schwere Schäden verursachen.

Note: 96-bay expansion nodes ship with cables for use with the chassis. These power cables have a right-angled notched C14 connector, which is required for the 96-bay expansion node. Only use the cords provided by Spectra Logic with the 96-bay expansion node.

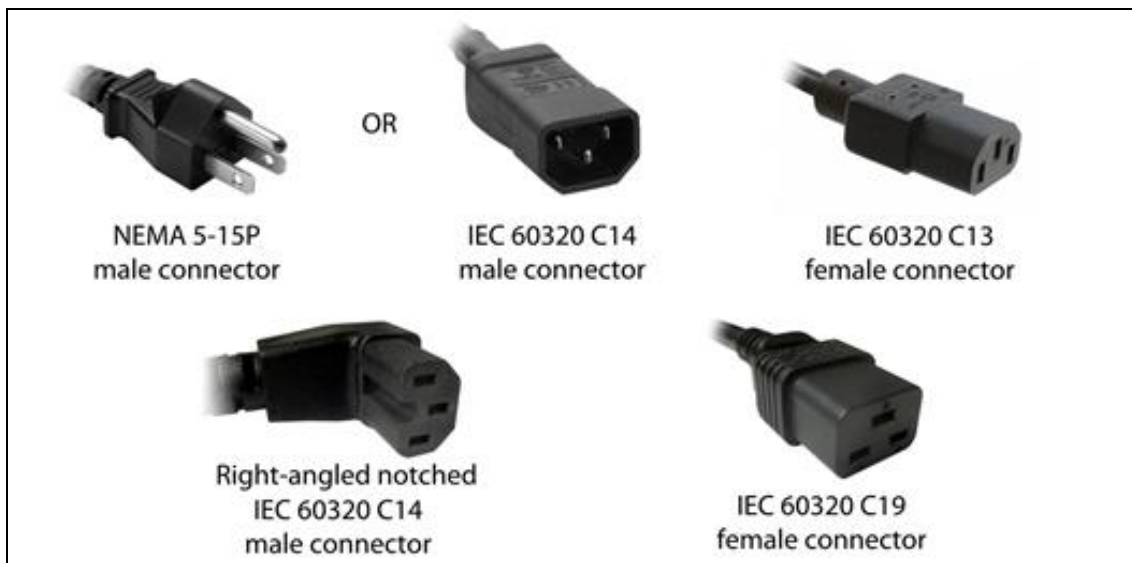

North American 120 Volt-AC Power Cord

The criteria for a 120-volt power cord for use in the United States and Canada are as follows:

Parameter	Specification
Power cordage	Three-conductor, 14 AWG
Power input connectors	Gen1 S, P and V Series, Gen2 X and V Series, Gen 3 H Series, and 44-Bay Expansion Node: • Male: NEMA 5-15P or IEC-60320 C14 • Female: IEC 60320 C13

North American 220 Volt-AC Power Cord

The criteria for a 220-volt power cord for use in the United States and Canada are as follows:

Parameter	Specification
Power cordage	SJT type, three-conductor, 14 AWG minimum
Power input connectors	Gen1 S, P, and V Series, Gen2 X, S, and V Series, Gen 3 H Series, Gen 3 F Series, and 44-Bay Expansion Node: • Male: NEMA 5-15P or IEC-60320 C14 • Female: IEC 60320 C13 77-Bay Chassis Expansion Node: • Male: Connector must be of the proper type, rating, and safety approval. • Female: IEC 60320 C19 96-Bay Expansion Node: • Male: Connector must be of the proper type, rating, and safety approval. • Female: Right-angled notched IEC 60320 C14 107-Bay Chassis Expansion Node: • Male: Connector must be of the proper type, rating, and safety approval. • Female: IEC 60320 C19

International 220 Volt-AC Power Cord

The criteria for an international 220-volt AC power cord are as follows:

Parameter	Specification
Power cordage	Flexible, HAR (harmonized) type H05VV-F, three conductor, cord with minimum conductor size of 1.7 square millimeters (0.0026350 square inches).
Power input connectors	Gen1 S, P, and V Series, Gen2 X, S, and V Series, Gen 3 H Series, Gen 3 F Series, and 44-Bay Expansion Node: • Male: Connector must be of the proper type, rating, and safety approval. • Female: IEC 60320 C13 77-Bay Chassis Expansion Node: • Male: Connector must be of the proper type, rating, and safety approval. • Female: IEC 60320 C19 96-Bay Expansion Node: • Male: Connector must be of the proper type, rating, and safety approval. • Female: Right-angled notched IEC 60320 C14 107-Bay Chassis Expansion Node: • Male: Connector must be of the proper type, rating, and safety approval. • Female: IEC 60320 C19

Power Connection Best Practice

For greater power redundancy, connect each of the two power cords to separate circuits.

INTERFACE SPECIFICATIONS

This section provides information about the interfaces used to connect a BlackPearl gateway to expansion nodes, tape drives, and host systems.

System Interface Connectors

Gen3 F Series BlackPearl Gateway

Interface Type	Number of Ports and Connector Type
Ethernet • 25 and 100 GigE	Two QSFP28 sockets.
IPMI Management Port	One RJ-45 socket.
SAS (12 Gbps) (Optional)	• Four SFF-8644 sockets per 12 Gbps SAS card provide connections to four 77-bay, or 107-bay disk expansion nodes, using one port per expansion node. • Four SFF-8644 sockets per 12 Gbps SAS card provide connection to sixteen SAS tape drives in the tape library, using one port for four tape drives. IMPORTANT If the BlackPearl system configuration includes both SAS tape drives and disk expansion nodes, separate HBAs must be used for each device type. If an OSW-2400 SAS Switch is used to connect to both tape drives and disk expansion nodes, a single SAS HBA is allowed.
Fibre Channel (16 Gb or 32 Gb) (Optional)	Four SFP+ optical modules with LC connectors per Fibre Channel card provide connections to four Fibre Channel tape drives in the tape library, using one port for each tape drive.

Gen3 H Series 3300 & 3310 BlackPearl Gateway

Interface Type	Number of Ports and Connector Type
Ethernet • 1 GigE • 25 and 100 GigE	Two RJ-45 sockets. Two QSFP28 sockets.
IPMI Management Port	One RJ-45 socket.
SAS (12 Gbps) (Optional)	• Four SFF-8644 sockets per 12 Gbps SAS card provide connections to four 77-bay, or 107-bay disk expansion nodes, using one port per expansion node. • Four SFF-8644 sockets per 12 Gbps SAS card provide connection to sixteen SAS tape drives in the tape library, using one port for four tape drives. IMPORTANT If the BlackPearl system configuration includes both SAS tape drives and disk expansion nodes, separate HBAs must be used for each device type. If an OSW-2400 SAS Switch is used to connect to both tape drives and disk expansion nodes, a single SAS HBA is allowed.
Fibre Channel (16 Gb or 32 Gb) (Optional)	Four SFP+ optical modules with LC connectors per Fibre Channel card provide connections to four Fibre Channel tape drives in the tape library, using one port for each tape drive.

Gen2 X Series BlackPearl Gateway

Interface Type	Number of Ports and Connector Type
Ethernet • 1 Gig E • 100 GigE	One RJ-45 socket Two QSFP28 sockets.
SAS (12 Gbps) (Optional)	• Four SFF-8644 sockets per 12 Gbps SAS card provide connections to four 77-bay, or 107-bay disk expansion nodes, using one port per expansion node. • Four SFF-8644 sockets per 12 Gbps SAS card provide connection to sixteen SAS tape drives, using one port for four tape drives. IMPORTANT If the BlackPearl system configuration includes both SAS tape drives and disk expansion nodes, separate HBAs must be used for each device type. If an OSW-2400 SAS Switch is used to connect to both tape drives and disk expansion nodes, a single SAS HBA is allowed.
Fibre Channel (16 Gb or 32 Gb) (Optional)	Four SFP+ optical modules with LC connectors per Fibre Channel card provide connections to four Fibre Channel tape drives in the tape library, using one port for each tape drive.

Gen2 S Series and V Series BlackPearl Gateway

Interface Type	Number of Ports and Connector Type
Ethernet 1 Gigabit (Gen2 V series only)	Two RJ-45 sockets.
Ethernet 10GBase-T (Gen2 S series only)	Two RJ-45 sockets.
IPMI Management Port	One RJ-45 socket.
Ethernet 10GBase-T (Optional)	Two RJ-45 sockets.
Ethernet (100 GigE) (Optional)	Two SFP28 optical modules with a duplex LC connector per optional 100 GigE NIC.
SAS (12 Gbps) (Optional)	• Four SFF-8644 sockets per 12 Gbps SAS card provide connections to four 77-bay, 96-bay, or 107-bay disk expansion nodes, using one port per expansion node. • Four SFF-8644 sockets per 12 Gbps SAS card provide connection to sixteen SAS tape drives, using one port for four tape drives. IMPORTANT If the BlackPearl system configuration includes both SAS tape drives and disk expansion nodes, separate HBAs must be used for each device type. If an OSW-2400 SAS Switch is used to connect to both tape drives and disk expansion nodes, a single SAS HBA is allowed.
Fibre Channel (8 Gb or 16 Gb) (Optional)	Four SFP+ optical modules with LC connectors per Fibre Channel card provide connections to four Fibre Channel tape drives in the tape library, using one port for each tape drive.

Gen1 S Series and Gen1 V Series BlackPearl Gateway

Interface Type	Number of Ports and Connector Type
Ethernet (1000BaseT, 10GBase-T)	Two RJ-45 sockets.
IPMI Management Port	One RJ-45 socket
Ethernet (10 GigE)	Two SFP+ optical modules with a duplex LC connector per optional 10 GigE NIC.
Ethernet (40 GigE)	Two QSFP+ optical modules with a duplex LC connector per optional 40 GigE NIC.
SAS (6 Gbps) (Optional)	• Four SFF-8644 sockets per optional 6 Gbps SAS card provide connections to two 44-bay expansion nodes, using two ports for each expansion node. • Four SFF-8644 sockets per optional 6 Gbps SAS card provide connections to 16 SAS tape drives, using one port for four tape drives. IMPORTANT If the BlackPearl system configuration includes both SAS tape drives and disk expansion nodes, separate HBAs must be used for each device type. If an OSW-2400 SAS Switch is used to connect to both tape drives and disk expansion nodes, a single SAS HBA is allowed.
SAS (12 Gbps) (Optional)	• Two or four SFF-8644 sockets per optional 12 Gbps SAS card provide connections to two or four 77-bay, 96-bay, or 107-bay disk expansion nodes, using one port per expansion node. • Two or four SFF-8644 sockets per optional 12 Gbps SAS card provide connection to eight or sixteen SAS tape drives, using one port for four tape drives. IMPORTANT If the BlackPearl system configuration includes both SAS tape drives and disk expansion nodes, separate HBAs must be used for each device type. If an OSW-2400 SAS Switch is used to connect to both tape drives and disk expansion nodes, a single SAS HBA is allowed.
Fibre Channel (8 Gb) (Optional)	Two or four SFP+ optical modules with LC connectors per optional 8 Gb Fibre Channel card provide connections to two Fibre Channel tape drives in the tape library, using one port for each tape drive.

Expansion Node and Tape Drive Interface Connectors

Interface Type	Number of Ports and Connector Type
44-Bay Expansion Node	Two SFF-8088 ports per 44-bay expansion node. Both ports are required to connect the expansion node to a BlackPearl gateway.
77-Bay Expansion Node	• Four SFF-8644 ports per expander in the 77-bay expansion node. Maximum of two expanders. • One 1 GigE Ethernet port per expander in the 77-bay expansion node. Maximum of two expanders.
96-Bay Expansion Node	Two SFF-8644 ports per 96-bay expansion node. Only a single port is required to connect the expansion node to a BlackPearl gateway.
107-Bay Expansion Node	• Four SFF-8644 ports per expander in the 107-bay expansion node. Maximum of two expanders. • One 1 GigE Ethernet port per expander in the 107-bay expansion node. Maximum of two expanders.
SAS Tape Drive	• T50e library: Two SFF-8088 ports per tape drive. Only a single port is required to connect the tape drive to a BlackPearl gateway. Either port can be used for the connection. • All other libraries: One SFF-8088 port per tape drive. The single port is required to connect the tape drive to a BlackPearl gateway.
Fibre Channel Tape Drive	• T50e and T120 libraries: One multimode optical LC port per tape drive. The single port is required to connect the tape drive to a BlackPearl gateway • All other libraries: Two multimode optical LC ports per tape drive. Only a single port is required to connect the tape drive to a BlackPearl gateway. Either port can be used for the connection.

Network Interface Cables

The type of cables required to connect the BlackPearl gateway to an Ethernet network, a 44-bay, 77-bay, 96-bay, or 107-bay expansion node, a SAS tape drive, or a Fibre Channel tape drive depend on the type of interface.

Interface Type	Cable Requirements
Ethernet (10GBase-T or 10/100/1000Base-T)	10GBase-T - Shielded Category 6A data-grade cable with an RJ-45 connector. 10/100/1000Base-T - Shielded Category 5 data-grade cable with an RJ-45 connector.

Interface Type	Cable Requirements
	Note: Cables to be provided by the customer.
Ethernet (10 GigE)	SFP+ transceiver multimode optical cable with duplex LC connectors. Note: Cables to be provided by the customer.
Ethernet (25 GigE)	SFP28 transceiver multimode optical cable with duplex LC connectors. Note: Cables to be provided by the customer.
Ethernet (40 GigE)	QSFP+ transceiver MPT optical cables with duplex LC connectors, or copper cables with QSFP+ connector. Note: Cables to be provided by the customer.
Ethernet (100 GigE)	100 GbE QSFP28 cable. Note: Cables to be provided by the customer.
SAS	44-bay expansion node: 6 Gbps 4 lane cable with SFF-8644 and SFF-8088 connectors. Two SAS cables are required for each 44-bay expansion node. Note: Two SAS cables are included with each 44-bay expansion node. 77-bay expansion node: 12 Gbps cable with SFF-8644 connectors. One SAS cable is required for each 77-bay expansion node. 96-bay expansion node: 12 Gbps cable with SFF-8644 connectors. One SAS cable is required for each 96-bay expansion node. 107-bay expansion node: 12 Gbps cable with SFF-8644 connectors. One SAS cable is required for each 107-bay expansion node. Note: One SAS cable is included with each 96-bay expansion node or 107-bay expansion node. SAS tape drive: 6 Gbps 4 lane fan-out cable with SFF-8644 and four SFF-8088 connectors. One SAS cable is required for every four SAS tape drives. Note: Cables to be provided by the customer.
Fibre Channel	50 micron—400-M5-SN-I classification optical cable with LC connectors. One fiber cable is required for each Fibre Channel tape drive. Note: Cables to be provided by the customer.

Networking Naming Conventions

SFP naming (LC fiber)

- 1G is SFP
- 10G is SFP+
- 25G is SFP28

QSFP naming (MPO/MTP fiber)

- 40G is QSFP+ (4 lanes)
- 50G is QSFP28 (2 lanes)
- 100G is QSFP28 (4 lanes)

Universal Serial Bus (USB) Support

Spectra Logic supports using the USB ports on the gateway for the following:

- USB mass storage devices (for example, flash drives)
- Keyboards & pointer devices (for example, a computer mouse)
- CD or DVD drives with USB interface

RACK-MOUNT REQUIREMENTS

Ensure that an appropriate rack is assembled and placed near the AC power outlets and network connections.

**CAUTION**

You must locate the rack on a level, hard-surfaced floor, such as cement or tile. Do not place the rack on a carpeted floor or anywhere else that poses risk for static discharge that could damage your system or its drives.

Two-Post Rack Restriction

Spectra Logic does not support the use of a two-post rack with a BlackPearl master node or expansion nodes.

Note: An enclosed 19-inch, four-post rack is available for purchase from Spectra Logic. The rack has two doors and removable side panels. Contact Spectra Logic Sales for more information (see [Contacting Spectra Logic](#)).

BlackPearl Master Nodes and 44-Bay Expansion Node

**IMPORTANT**

If your BlackPearl system includes a 96-bay or 107-bay expansion node, you must install the BlackPearl master node using the rack requirements for the expansion node. See [96-Bay Expansion Node on the next page](#) or [107-Bay Expansion Node on page 52](#)

The BlackPearl gateway 4U master node and 44-bay expansion node are 7 inches (17.8 cm) tall and occupies 4U of rack space. The BlackPearl gateway 2U master nodes are 3.5 inches (8.9 cm) tall and occupy 2U of rack space. All are designed to fit in a standard 19-inch, 4-post rack. Keep the following in mind when selecting a rack:

- Make sure that the distance between the mounting surfaces on the front and rear posts is between 27 inches (68.6 cm) and 36 inches (91 cm).
Note: If you are using the adaptors to install the rack-mount kit in a rack with circular mounting cutouts, the distance between the front and rear posts must be at least 28.5 inches (72.4 cm), and not more than 37.5 inches (95.25 cm).
- Allow approximately 3 inches (8 cm) of additional depth at the back of the rack for cable clearance.
- If the rack has a door, allow at least 2 inches (5 cm) of clearance between the front door frame and the front mounting posts of the rack to allow the door to close over the front bezel.
- Check your rack's specifications to make sure it accommodates the weight and depth of the BlackPearl system. See [Physical Requirements on page 17](#) for more information.

- In earthquake prone areas, provide restraints as necessary. See [Stability & Bolt Down Kits on page 29](#).

77-Bay Expansion Node

The 77-bay expansion node chassis is 6.9 inches (17.5 cm) tall and occupies 4U of rack space; it fits in a standard 19-inch, 4-post rack. Keep the following in mind when selecting a rack:

- Make sure that the distance between the mounting surfaces on the front and rear posts is between 19 inches (48.3 cm) and 30 inches (76.2 cm).
- Allow approximately 3 inches (8 cm) of additional depth at the back of the rack for cable clearance.
- If the rack has a door, allow at least 2 inches (5 cm) of clearance between the front door frame and the front mounting posts of the rack to allow the door to close over the front bezel.
- Check your rack's specifications to make sure it accommodates the weight and depth of the 77-bay expansion node. See [Physical Requirements on page 17](#) for more information.
- Anchor the rack to the floor with a rack bolt down kit. See [Stability & Bolt Down Kits on page 29](#).



WARNING

The rack must be anchored to the floor before the 77-bay expansion node is installed to eliminate the risk of tipping when a fully loaded 77-bay expansion node is extended from the rack, which could lead to personal injury.

WARNUNG Das Rack muss am Boden verankert werden, bevor das 77-bay Erweiterungsknoten installiert ist, um die Kippgefahr zu beseitigen, wenn ein voll beladener 77-bay Erweiterungsknoten aus dem Rack, die zu Personenschäden führen könnte erweitert.

- In earthquake prone areas, provide restraints as necessary. See [Stability & Bolt Down Kits on page 29](#).

96-Bay Expansion Node

The 96-bay expansion node chassis is 6.9 inches (17.5 cm) tall and occupies 4U of rack space; it fits in a standard 19-inch, 4-post rack. Keep the following in mind when selecting a rack:

- Make sure that the distance between the mounting surfaces on the front and rear posts is between 19 inches (48.3 cm) and 30 inches (76.2 cm).
- Allow approximately 3 inches (8 cm) of additional depth at the back of the rack for cable clearance.
- If the rack has a door, allow at least 2 inches (5 cm) of clearance between the front door frame and the front mounting posts of the rack to allow the door to close over the front bezel.

- Check your rack's specifications to make sure it accommodates the weight and depth of the 96-bay expansion node. See [Physical Requirements on page 17](#) for more information.
- Anchor the rack to the floor with a rack bolt down kit. See [Stability & Bolt Down Kits on page 29](#).



WARNING

The rack must be anchored to the floor before the 96-bay expansion node is installed to eliminate the risk of tipping when a fully loaded 96-bay expansion node is extended from the rack, which could lead to personal injury.

WARNUNG Das Rack muss am Boden verankert werden, bevor das 96-bay Erweiterungsknoten installiert ist, um die Kippgefahr zu beseitigen, wenn ein voll beladener 96-bay Erweiterungsknoten aus dem Rack, die zu Personenschäden führen könnte erweitert.

- In earthquake prone areas, provide restraints as necessary. See [Stability & Bolt Down Kits on page 29](#).

107-Bay Expansion Node

The 107-bay expansion node chassis is 6.9 inches (17.5 cm) tall and occupies 4U of rack space; it fits in a standard 19-inch, 4-post rack. Keep the following in mind when selecting a rack:

- Make sure that the distance between the mounting surfaces on the front and rear posts is between 31 inches (78.6 cm) and 36.4 inches (92.4 cm).
- Allow approximately 3 inches (8 cm) of additional depth at the back of the rack for cable clearance.
- If the rack has a door, allow at least 2 inches (5 cm) of clearance between the front door frame and the front mounting posts of the rack to allow the door to close over the front bezel.
- Check your rack's specifications to make sure it accommodates the weight and depth of the 107-bay expansion node. See [Physical Requirements on page 17](#) for more information.
- Anchor the rack to the floor with a rack bolt down kit. See [Stability & Bolt Down Kits on page 29](#).



WARNING

The rack must be anchored to the floor before the 107-bay expansion node is installed to eliminate the risk of tipping when a fully loaded 107-bay expansion node is extended from the rack, which could lead to personal injury.

WARNUNG Das Rack muss am Boden verankert werden, bevor das 107-bay Erweiterungsknoten installiert ist, um die Kippgefahr zu beseitigen, wenn ein voll beladener 107-bay Erweiterungsknoten aus dem Rack, die zu Personenschäden führen könnte erweitert.

- In earthquake prone areas, provide restraints as necessary. See [Stability & Bolt Down Kits on page 29](#).

Rack Mount Tipping Best Practice

It is a best practice to place a BlackPearl chassis in the lowest part of the rack as possible to prevent tipping.